

627 RIVERBANK DRIVE  
GENEVA, IL 60134  
630-232-0104

## Test Report

[www.riverbankacoustics.com](http://www.riverbankacoustics.com)

FOUNDED 1918 BY  
WALLACE CLEMENT SABINE

SPONSOR: **Carnegie Fabrics, LLC**  
Rockville Centre, NY

**Sound Absorption**  
**RAL™-A24-392**

CONDUCTED: 2024-09-26

Page 1 of 9

ON: Ace Baffle (12 units, 2 rows of 6 units each, rows spaced 12" apart, units in each row spaced 24" o.c.)

### TEST METHODOLOGY

Riverbank Acoustical Laboratories™ is accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) as an ISO 17025:2017 Laboratory (NVLAP Lab Code: 100227-0) and for this test procedure. The test reported in this document conformed explicitly with ASTM C423-23: "Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method." The specimen mounting was performed according to ASTM E795-23: "Standard Practices for Mounting Test Specimens During Sound Absorption Tests." A description of the measurement procedure and room specifications are available upon request. The results presented in this report apply to the sample as received from the test sponsor.

### INFORMATION PROVIDED BY SPONSOR

The test specimen was designated by the sponsor as Ace Baffle (12 units, 2 rows of 6 units each, rows spaced 12" apart, units in each row spaced 24" o.c.). The following nominal product information was provided by the sponsor prior to testing. The accuracy of such sponsor-provided information can affect the validity of the test results.

#### **Product Under Test**

Product Name: Kirei Ace Baffle  
Manufacturer: Carnegie Fabrics, LLC  
Product Type: Acoustical PET Baffle

### SPECIMEN MEASUREMENTS & TEST CONDITIONS

Through a full external visual inspection performed on the test specimen, Riverbank personnel verified the following information:

#### **Test Specimen**

Dimensions: 12 baffles @ 140 mm (5.5 in.) wide by 1219 mm (48 in.) long  
Depth: 216 mm (8.5 in.)  
Overall Weight: 22.34 kg (49.25 lbs)

Carnegie Fabrics, LLC  
2024-09-26

**RAL™-A24-392**  
Page 2 of 9

### Physical Measurements (per object)

Dimensions: 1.22 m (48.0 in) wide by 0.22 m (8.5 in) long  
Thickness: 0.14 m (5.5 in)  
Weight: 1.86 kg (4.1 lbs)

### Test Environment

Room Volume: 291.98 m<sup>3</sup>  
Temperature: 22.0 °C ± 0.1 °C (Requirement: ≥ 10 °C and ≤ 5 °C change)  
Relative Humidity: 56.45 % ± 0.5 % (Requirement: ≥ 40 % and ≤ 5 % change)  
Barometric Pressure: 98.7 kPa (Requirement not defined)

Each sound absorbing object had an exposed surface area of 0.90 m<sup>2</sup> (9.66 ft<sup>2</sup>). The total exposed surface area of all sound-absorbing objects was 10.8 m<sup>2</sup> (116 ft<sup>2</sup>). These values are based on a simplification of the specimen object geometry to that of the smallest rectangular prism fully encompassing an object.

### MOUNTING METHOD

Type JV-MOD Mounting: The specimen is an array of 12 spaced sound absorbing objects suspended from cables such that the closest face is located approximately 1168 mm (46 in.) from the horizontal test surface. This approximates the mounting method of a typical ceiling baffle installation. The objects were distributed in two rows of six objects each, with rows spaced 305 mm (12 in.) apart, and objects in each row spaced 610 mm (24 in.) on center. The width of the installed object array was 3191 mm (125.625 in.) and the length of the installed object array was 2743 mm (108 in.). The area of extended continuous surface attributed to the object array was 11.2 m<sup>2</sup> (120 ft<sup>2</sup>).

## Test Report

Carnegie Fabrics, LLC  
2024-09-26

RAL™-A24-392  
Page 3 of 9



Figure 1 – Specimen mounted in test chamber

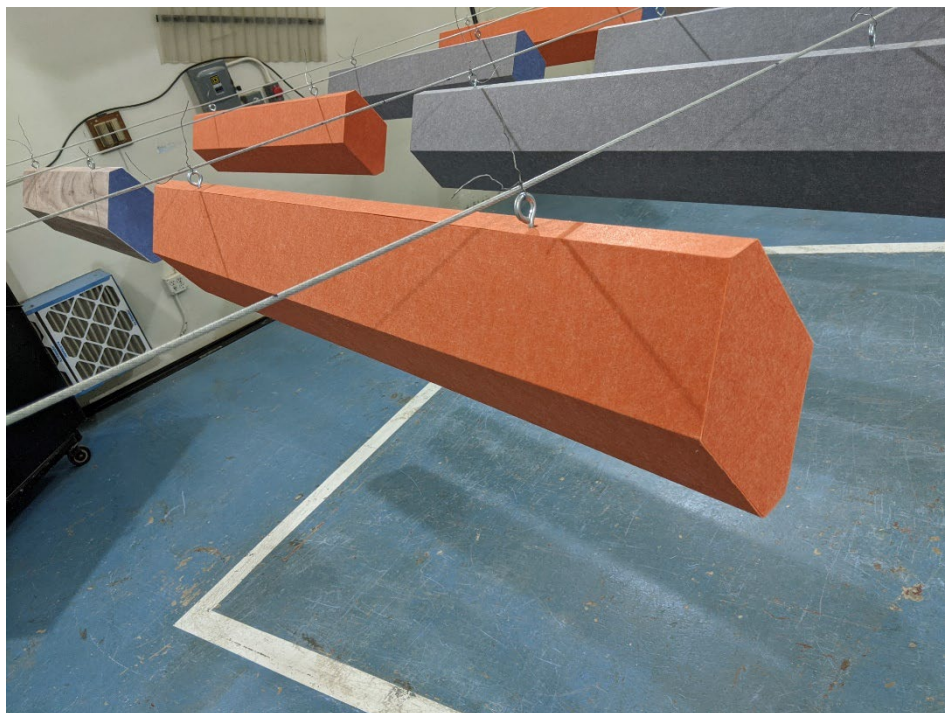


Figure 2 – Individual specimen object



## Test Report

Carnegie Fabrics, LLC  
2024-09-26

RAL™-A24-392  
Page 4 of 9



Figure 3 – Detail of specimen materials

Carnegie Fabrics, LLC  
2024-09-26**RAL™-A24-392**  
Page 5 of 9**TEST RESULTS**

The preferred presentation of sound absorption test results for arrays of spaced objects is sound absorption ( $\text{m}^2$ ) per object and total sound absorption ( $\text{m}^2$ ) at each one-third-octave band

ASTM C423-23 Appendix X2 allows calculation of sound absorption per  $\text{m}^2$  ( $\text{SA}/\text{m}^2$ ) based on the projected horizontal surface area attributable to an array of objects. The extended continuous surface area used in this calculation is to be determined using the following procedure:

$S_{\text{array}} = (w + w_1) \times (l + l_1)$  If the set of objects consists of a rectangular array of equal sized objects with equal space between each object in a row and equal space between rows. (ASTM E423-23 X.2.3.1)

Where:

$S_{\text{array}}$  = area of extended continuous surface attributed to the test specimen,  $\text{m}^2$

$w$  = the measured width of the installed object array, in meters

$w_1$  = the space between objects in the array along the width, in meters

$l$  = the measured length of the installed object array, in meters

$l_1$  = the space between objects in the array along the length, in meters

The sound absorption per  $\text{m}^2$  ( $\text{SA}/\text{m}^2$ ) is calculated based on the following formula:

$$\alpha_{\text{array}} = (A_2 - A_1)/S_{\text{array}}$$

Where:

$\alpha_{\text{array}}$  = sound absorption per  $\text{m}^2$  ( $\text{SA}/\text{m}^2$ ) of extended continuous surface, no units,

$A_1$  = absorption of the empty reverberation room,  $\text{m}^2$  and

$A_2$  = absorption of the room after the specimen has been installed,  $\text{m}^2$ .

$S_{\text{array}}$  = area of extended continuous surface attributed to the test specimen,  $\text{m}^2$

Carnegie Fabrics, LLC  
2024-09-26

**RAL™-A24-392**  
Page 6 of 9

### TEST RESULTS (continued)

1/3 Octave Center Frequency (Hz)	Total Absorption		Absorption per Object		$\alpha_{array}$ (Sabins/ft <sup>2</sup> ) (SA/m <sup>2</sup> )
	(m <sup>2</sup> )	(Sabins)	(m <sup>2</sup> / Object)	(Sabins / Object)	
100	0.55	5.91	0.05	0.49	0.05
** 125	0.28	3.02	0.02	0.25	0.03
160	1.00	10.78	0.08	0.90	0.09
200	1.36	14.61	0.11	1.22	0.12
** 250	2.42	26.06	0.20	2.17	0.22
315	3.45	37.11	0.29	3.09	0.31
400	4.30	46.25	0.36	3.85	0.39
** 500	5.42	58.30	0.45	4.86	0.49
630	6.14	66.06	0.51	5.51	0.55
800	6.28	67.62	0.52	5.63	0.56
** 1000	6.67	71.76	0.56	5.98	0.60
1250	7.42	79.84	0.62	6.65	0.66
1600	7.83	84.25	0.65	7.02	0.70
** 2000	8.47	91.15	0.71	7.60	0.76
2500	8.90	95.83	0.74	7.99	0.80
3150	9.22	99.22	0.77	8.27	0.83
** 4000	9.10	97.95	0.76	8.16	0.82
5000	9.00	96.86	0.75	8.07	0.81

**Array-NRC 0.50** over 11.2 m<sup>2</sup> of extended continuous surface area

**Array-SAA 0.51** over 11.2 m<sup>2</sup> of extended continuous surface area

Tested by

Marc Sciaky  
Senior Experimentalist

Report by

Keith Kimberling  
Test Engineer

Approved by

Eric P. Wolfram  
Laboratory Manager


*Note: Sound absorption per m<sup>2</sup> (SA/m<sup>2</sup>), and therefore the reported Single Number Ratings, are highly dependent on the exact sample shape, size, spacing, and extended continuous surface area present in the test and subsequent calculations. Changes to any of these parameters will change the resulting values. These presented results are valid only for the specific configuration present in this test.*

Carnegie Fabrics, LLC  
2024-09-26

**RAL™-A24-392**  
Page 7 of 9

### SOUND ABSORPTION REPORT

Ace Baffle (12 units, 2 rows of 6 units each, rows spaced 12" apart, units in each row spaced 24" o.c.)

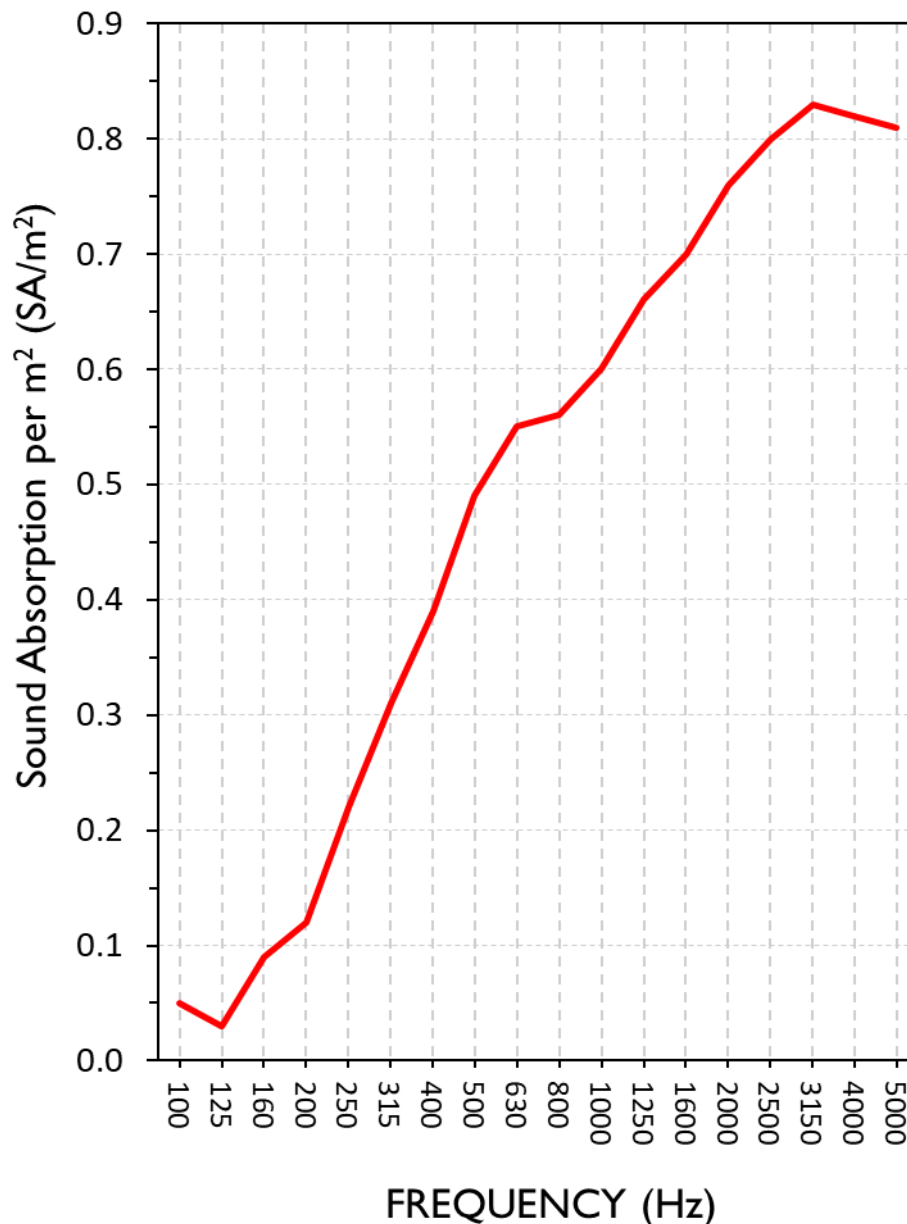

**Array-NRC 0.50** over 11.2 m² of extended continuous surface area

**Array-SAA 0.51** over 11.2 m² of extended continuous surface area

Carnegie Fabrics, LLC  
2024-09-26

**RAL™-A24-392**  
Page 8 of 9

### APPENDIX A: Extended Frequency Range Data

Specimen: Ace Baffle (12 units, 2 rows of 6 units each, rows spaced 12" apart, units in each row spaced 24" o.c.) (See Full Report)

*The following non-accredited data were obtained in accordance with ASTM C423-23, but extend beyond the defined frequency range of 100Hz to 5,000Hz. These unofficial results are representative of the RAL test environment only and intended for research & comparison purposes.*

1/3 Octave Band Center Frequency	Total Absorption		Absorption per Object		$\alpha_{array}$ (Sabins/ft <sup>2</sup> )
(Hz)	(m <sup>2</sup> )	(Sabins)	(m <sup>2</sup> / Object)	(Sabins / Object)	(SA/m <sup>2</sup> )
31.5	-0.01	-0.09	0.00	-0.01	0.00
40	0.62	6.70	0.05	0.56	0.06
50	-0.90	-9.73	-0.08	-0.81	-0.08
63	0.24	2.61	0.02	0.22	0.02
80	0.77	8.26	0.06	0.69	0.07
100	0.55	5.91	0.05	0.49	0.05
125	0.28	3.02	0.02	0.25	0.03
160	1.00	10.78	0.08	0.90	0.09
200	1.36	14.61	0.11	1.22	0.12
250	2.42	26.06	0.20	2.17	0.22
315	3.45	37.11	0.29	3.09	0.31
400	4.30	46.25	0.36	3.85	0.39
500	5.42	58.30	0.45	4.86	0.49
630	6.14	66.06	0.51	5.51	0.55
800	6.28	67.62	0.52	5.63	0.56
1000	6.67	71.76	0.56	5.98	0.60
1250	7.42	79.84	0.62	6.65	0.66
1600	7.83	84.25	0.65	7.02	0.70
2000	8.47	91.15	0.71	7.60	0.76
2500	8.90	95.83	0.74	7.99	0.80
3150	9.22	99.22	0.77	8.27	0.83
4000	9.10	97.95	0.76	8.16	0.82
5000	9.00	96.86	0.75	8.07	0.81
6300	9.02	97.12	0.75	8.09	0.81
8000	9.21	99.15	0.77	8.26	0.83
10000	8.86	95.38	0.74	7.95	0.79
12500	9.42	101.44	0.79	8.45	0.84



Carnegie Fabrics, LLC  
2024-09-26

**RAL™-A24-392**  
Page 9 of 9

### **APPENDIX B: Instruments of Traceability**

Specimen: Ace Baffle (12 units, 2 rows of 6 units each, rows spaced 12" apart, units in each row spaced 24" o.c.) (See Full Report)

<b><u>Description</u></b>	<b><u>Model</u></b>	<b><u>Serial Number</u></b>	<b><u>Date of Certification</u></b>	<b><u>Calibration Due</u></b>
System 1	Type 3160-A-042	3160-106974	2024-08-15	2025-08-15
Bruel & Kjaer Mic And Preamp G	Type 4943-B-001	2525858	2024-05-07	2025-05-07
Bruel & Kjaer Pistonphone	Type 4228	2781248	2024-07-19	2025-07-19
EXTECH Hygro 959	SD700	A099959	2024-03-29	2025-03-29

### **APPENDIX C: Revisions to Original Test Report**

Specimen: Ace Baffle (12 units, 2 rows of 6 units each, rows spaced 12" apart, units in each row spaced 24" o.c.) (See Full Report)

<b><u>Date</u></b>	<b><u>Revision</u></b>
2024-10-23	Original report issued

---

END