



Installation Manual: PAD100-SM Speaker Module

NOTICE TO THE INSTALLER

This manual provides an overview and the installation instructions for the PAD100-SM module. This module is only compatible with addressable fire systems that utilize the PAD Addressable Protocol.

All terminals are power limited and should be wired in accordance with the requirements of NFPA 70 (NEC) and NFPA 72 (National Fire Alarm Code). Failure to follow the wiring diagrams in the following pages will cause the system to not operate as intended. For further information, refer to the control panel installation instructions.

The module shall only be installed with listed control panels. Refer to the control panel installation manual for proper system operation.

1. Description


The PAD100-SM uses one (1) SLC loop address. The module mounts on either an UL Listed 2-1/2" deep 2-gang box or 1-1/2" deep 4" square box. The module is capable of switching one of the two audio input channels to its audio output channel.

The PAD100-SM includes one red LED to indicate the module's status. In normal condition, the LED flashes when the device is being polled by the control panel. If the LED blink has been disabled via the programming software, in a normal condition the LED of the device will be off.

2. Setting the Address

All PAD protocol detectors and modules require an address prior to connection to the panel's SLC loop. Each PAD device's address (*i.e.*, *detector and/or module*) is set by changing the dip switches located on the device. PAD device addresses are comprised of a **seven (7) position dip switch** used to program each device with an address ranging from 1–127. For example, if the address number assigned is "8", the first input will be identified as "8.1", and the second input channel will be "8.2."


Figure 1. PAD Device Dip Switch Addresses Table (Addresses 1–127)

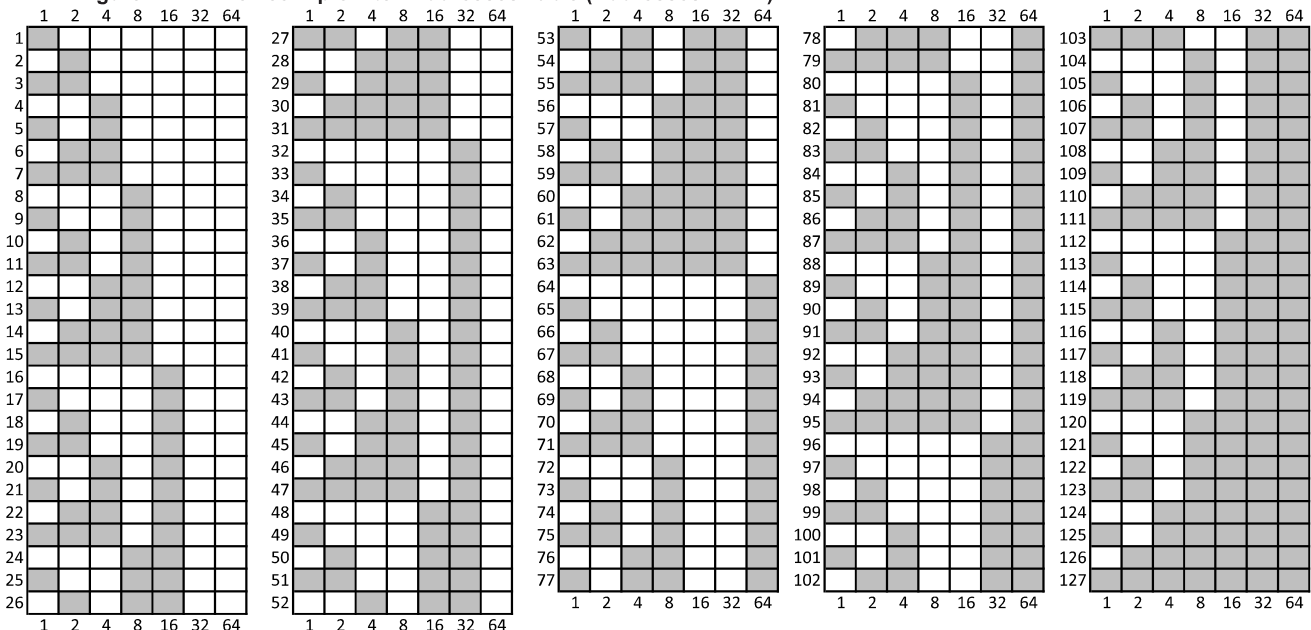


Note: Each **"gray" box** indicates that the dip switch is **"On,"** and each **"white" box** indicates **"Off."**

The examples shown below illustrate a PAD device's dip switch settings: the 1st example shows a device *not addressed* where all dip switch settings are in the *default "Off" position*, the 2nd illustrates an *addressed PAD device* via the dip switch settings.

Figure 2. Examples of PAD Device Showing Default Dip Switch Setting (Unaddressed) & Addressed PAD Device



All dip switches are shown in the "Off" position.



Example shows this PAD device's address = 42. Dip switches #2, 8 & 32 are in the "On" position.

INSTALLATION MANUAL: PAD100-SM SPEAKER MODULE

Before connecting a device to the SLC loop, take the following precautions to prevent potential damage to the SLC or device.

- Power to the SLC is removed.
- Field wiring on module is correctly installed.
- Field wiring has no open or short circuits.

3. Technical Specifications

Operating Voltage	24.0V
Max SLC Standby Current	240 μ A
Max SLC Alarm Current	240 μ A
Output Channel Ratings	2A @ 30VDC, 0.5A @ 25VAC, 60 Watts
Input Channel Ratings	25 VRMS, 70.7 VRMS, 30 VDC, 120 VAC
EOL Resistor	5.1K Ω
Operating Temperature Range	32° to 120° F (0° to 49° C)
Operating Humidity Range	0 to 93% (non-condensing)
Max no. of Module Per Loop	127 units
Dimensions	4.17" L x 4.17" W x 1.14" D
Mounting Options	UL Listed 2-1/2" deep 2-gang box or 1-1/2" deep 4" square box
Shipping Weight	0.6 lbs

4. Wiring Diagrams

The wiring diagram shown below illustrates how to wire a PAD100-SM module. Additionally, an installation diagram shows how to install the module using a compatible electrical box.

Figure 3. Example of Installing a PAD100-SM Using a Compatible Electrical Box

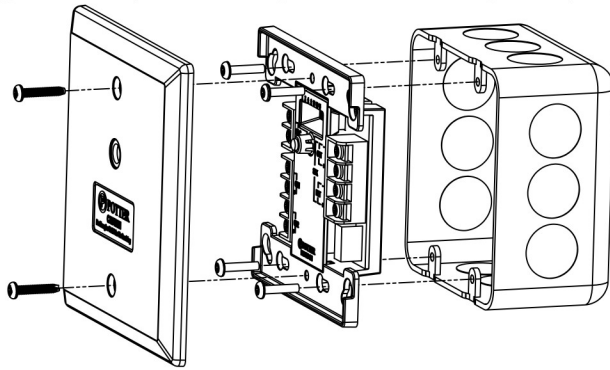


Figure 4. Example of Wiring a PAD100-SM as Class B Output Channel


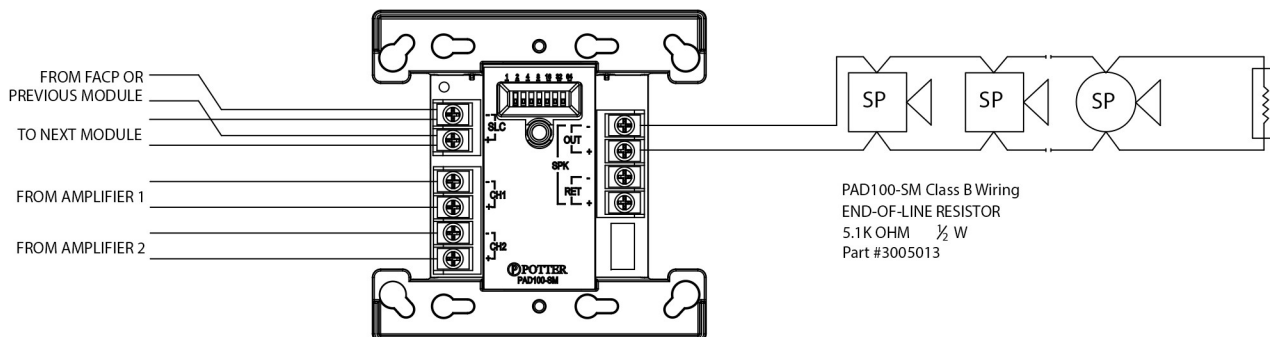


Figure 5. Example of Wiring a PAD100-SM as Class A Output Channel



Notes:

- SLC wiring style supports the Class A, Class B and Class X.
- Output channel wiring supports Class A or Class B wiring styles.
- SLC loop wiring (SLC+, SLC-) are power limited.
- Wiring for terminals SLC+, SLC- are supervised.
- All wiring is between #12 (max.) and #22 (min.).
- Wire Preparation – Strip all wires 1/4 inch from their edges as shown here:
 - Stripping too much insulation may cause a ground fault.
 - Stripping too little may cause a poor connection and subsequently an open circuit.

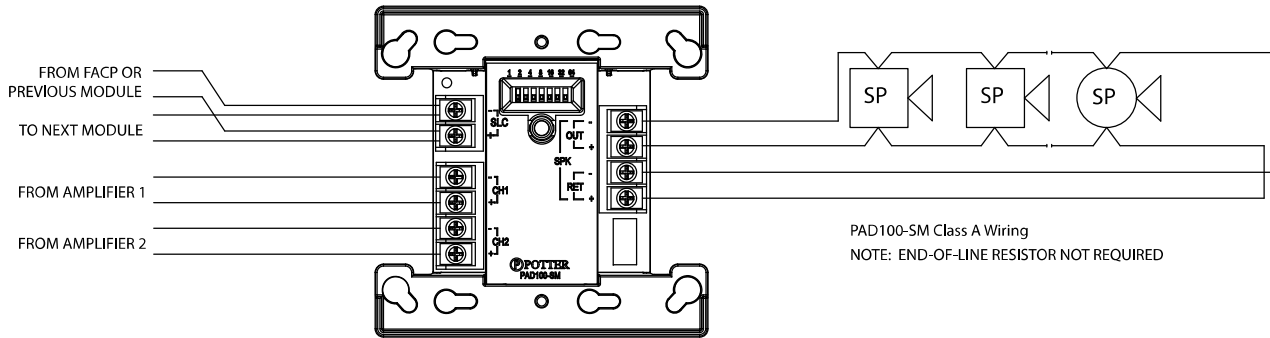

NOTICE

It is possible that the internal relay in the PAD100-SM may be shipped in the non-normal / activated state. To ensure that the internal relay is set to the normal state, connect the module to the SLC loop and reset the control panel before terminating the wiring to the module's output.

These instructions do not purport to cover all the details or variations in the equipment described, nor provide for every possible contingency to be met in connection with installation, operation and maintenance.

Specifications subject to change without prior notification.

For Technical Assistance contact Potter Electric Signal Company at 866-956-1211.

Actual performance is based on proper application of the product by a qualified professional.

Should further information be desired or should particular problems arise, which are not covered sufficiently for the purchaser's purpose, the matter should be referred to a distributor in your region.