

Installation Manual: PAD100-TRTI Two Relay Two Input Module

NOTICE TO THE INSTALLER

This manual provides an overview and the installation instructions for the PAD100-TRTI module. This module is only compatible with addressable fire systems that utilize the PAD Addressable Protocol.

All terminals are power limited and should be wired in accordance with the requirements of NFPA 70 (NEC) and NFPA 72 (National Fire Alarm Code). Failure to follow the wiring diagrams in the following pages will cause the system to not operate as intended. For further information, refer to the control panel installation instructions.

The module shall only be installed with listed control panels. Refer to the control panel installation manual for proper system operation.

1. Description

The PAD100-TRTI uses one (1) SLC loop address when monitoring two (2) Class B circuits or one (1) Class A circuit. The PAD100-TRTI also provides two (2) Form C relay contacts. The module mounts on either an UL Listed 2-1/2" deep 2-gang box or 1-1/2" deep 4" square box. The PAD100-TRTI is capable of monitoring two (2) separate Class B circuits making it ideal for monitoring sprinkler waterflow and valve tamper switches when they are located in the same proximity.

The PAD100-TRTI includes one red LED to indicate the module's status. In normal condition, the LED flashes when the device is being polled by the control panel. When an input is activated, the LED will flash at a fast rate. If the LED blink has been disabled via the programming software, in a normal condition the LED of the device will be off. All other conditions remain the same.

2. Setting the Address

All PAD protocol detectors and modules require an address prior to connection to the panel's SLC loop. Each PAD device's address (*i.e.*, detector and/or module) is set by changing the dip switches located on the device. PAD device addresses are comprised of a **seven (7) position dip switch** used to program each device with an address ranging from 1–127.


Figure 1. PAD Device Dip Switch Addresses Table (Addresses 1–127)

1	2	4	8	16	32	64	1	2	4	8	16	32	64	1	2	4	8	16	32	64	1	2	4	8	16	32	64	1	2	4	8	16	32	64	1	2	4	8	16	32	64					
1							27							53							79							103																		
2							28							54							80							104																		
3							29							55							81							105																		
4							30							56							82							106																		
5							31							57							83							107																		
6							32							58							84							108																		
7							33							59							85							109																		
8							34							60							86							110																		
9							35							61							87							111																		
10							36							62							88							112																		
11							37							63							89							113																		
12							38							64							90							114																		
13							39							65							91							115																		
14							40							66							92							116																		
15							41							67							93							117																		
16							42							68							94							118																		
17							43							69							95							119																		
18							44							70							96							120																		
19							45							71							97							121																		
20							46							72							98							122																		
21							47							73							99							123																		
22							48							74							100							124																		
23							49							75							101							125																		
24							50							76							102							126																		
25							51							77														127																		
26							52																																							

Note: Each "gray" box indicates that the dip switch is "On," and each "white" box indicates "Off."

The examples shown below illustrate a PAD device's dip switch settings: the 1st example shows a device *not addressed* where all dip switch settings are in the *default "Off" position*, the 2nd illustrates an *addressed PAD device* via the dip switch settings.

Figure 2. Examples of PAD Device Showing Default Dip Switch Setting (Unaddressed) & Addressed PAD Device



All dip switches are shown in the "Off" position.



Example shows this PAD device's address = 42. Dip switches #2, 8 & 32 are in the "On" position.

When the PAD100-TRTI is used to monitor two individual Class B circuits, a single device address is assigned; each input and relay is then identified as a sub-point of the module address. For example, if the address number is assigned as "8", the "RLY1" relay will be identified as "8.1", the "RLY2" relay will be identified as "8.2", the "B1" input will be "8.3", and the "B2" input will be "8.4."

Before connecting a device to the SLC loop, take the following precautions to prevent potential damage to the SLC or device.

- Power to the SLC is removed.
- Field wiring on module is correctly installed.
- Field wiring has no open or short circuits.

3. Technical Specifications

Operating Voltage	24.0V
Max SLC Standby Current	240 μ A
Max SLC Alarm Current	240 μ A
Relay Contacts	2A @30VDC, 0.5A @125VAC
Max Wiring Resistance of IDC	100 Ω
Max Wiring Capacitance of IDC	1 μ F
Max IDC Voltage	2.05 VDC
Max IDC Current	120 μ A
EOL Resistor	5.1K Ω
Operating Temperature Range	32° to 120° F (0° to 49° C)
Operating Humidity Range	0 to 93% (non-condensing)
Max no. of Module Per Loop	127 units
Dimensions	4.17" L x 4.17" W x 1.14" D
Mounting Options	UL Listed 2-1/2" deep 2-gang box or 1-1/2" deep 4" square box
Shipping Weight	0.6 lbs

4. Wiring Diagrams

The following wiring diagrams illustrate how to wire a PAD100-TRTI module as a Class A and Class B circuit. Additionally, an installation diagram shows how to install the module using a compatible electrical box.

Figure 3. Example of Installing a PAD100-TRTI Using a Compatible Electrical Box

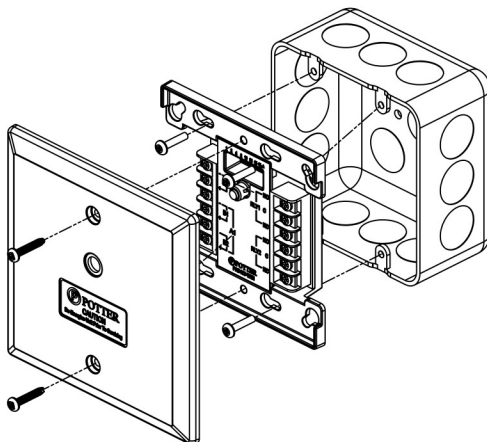


Figure 4. Example of Wiring a PAD100-TRTI with One Class A Circuit


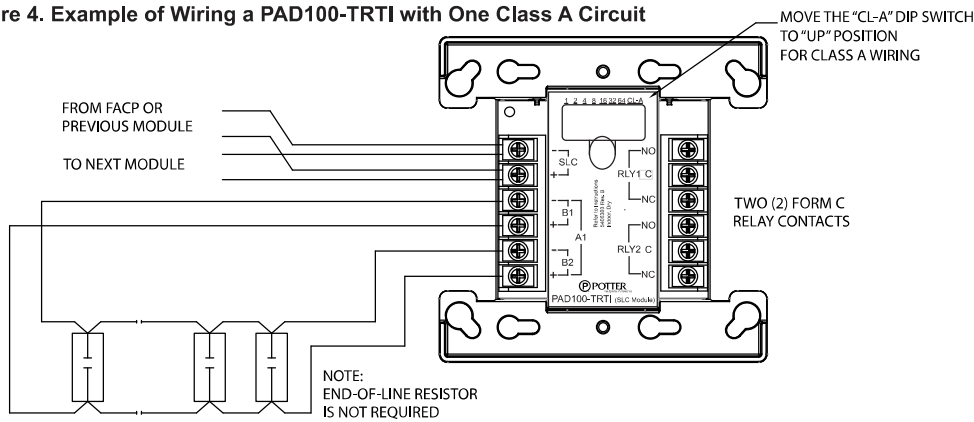


Figure 5. Example of Wiring a PAD100-TRTI with Two Class B Circuits

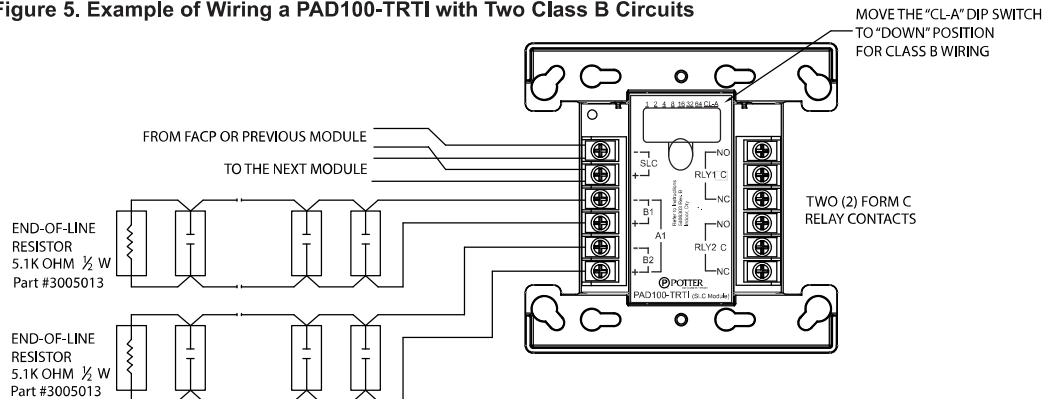

Notes:

- Contact output wiring is power limited when the device power supply is power limited. Contact output wiring is non-power limited when the device power supply is non-power limited. When using non power limited wiring, it must use an alternate opening in the back box and the wire routed at least 1/4 inches from the SLC wiring.
- SLC wiring style supports the Class A, Class B and Class X.
- IDC wiring style supports Class A and Class B.
- SLC loop wiring (SLC+, SLC-), initiating device wiring (B1, B2) are power limited.
- Wiring for terminals SLC+, SLC- are supervised.
- Wiring for terminals (B1, B2) are supervised.
- This addressable module does not support 2-wire detectors.
- All wiring is between #12 (max.) and #22 (min.).
- Wire Preparation – Strip all wires 1/4 inch from their edges as shown here:

 1/4 inch

NOTICE

It is possible that the internal relay in the PAD100-TRTI may be shipped in the non-normal / activated state. To ensure that the internal relay is set to the normal state, connect the module to the SLC loop and reset the control panel before terminating the wiring to the modules output.

These instructions do not purport to cover all the details or variations in the equipment described, nor provide for every possible contingency to be met in connection with installation, operation and maintenance.

Specifications subject to change without prior notification.

For Technical Assistance contact Potter Electric Signal Company at 866-956-1211.

Actual performance is based on proper application of the product by a qualified professional.

Should further information be desired or should particular problems arise, which are not covered sufficiently for the purchaser's purpose, the matter should be referred to a distributor in your region.