


Rev	Description of Change	ECN	Date
B	Label redraw, UL10th	151062	1/18/22

54712:B — Page 1 of 2


VENDOR NOTES:

1. Printed on 8.5 x 11" paper
2. Shall be printed black lettering on white background
3. Document is folded & placed in pouch (PN 120528) on cabinet

Material: Fasson Adhesive Spec #08486 NO SUBSTITUTIONS!	Approvals	Name	Date	Honeywell  12 Clintonville Road, Northford, CT 06472
	Drawn by	Wendy Chadbourne	1/18/2022	
	Technical Publications			
Finish: Background: White, Lettering: Black	Quality Assurance			Title: Wiring Diagram, SK-FFT Document: 54712 Rev: B Sheet: 1 of 2 Scale: 1:1 Current ECN: 151062
Used on: SK-FFT	Marketing			
	Documentation			
	Agency Listing			
	REM			
Filename: 54712:B	Tolerances +/- 0.030"	Unless otherwise specified, ASA standards are followed and all dimensions are in inches.		

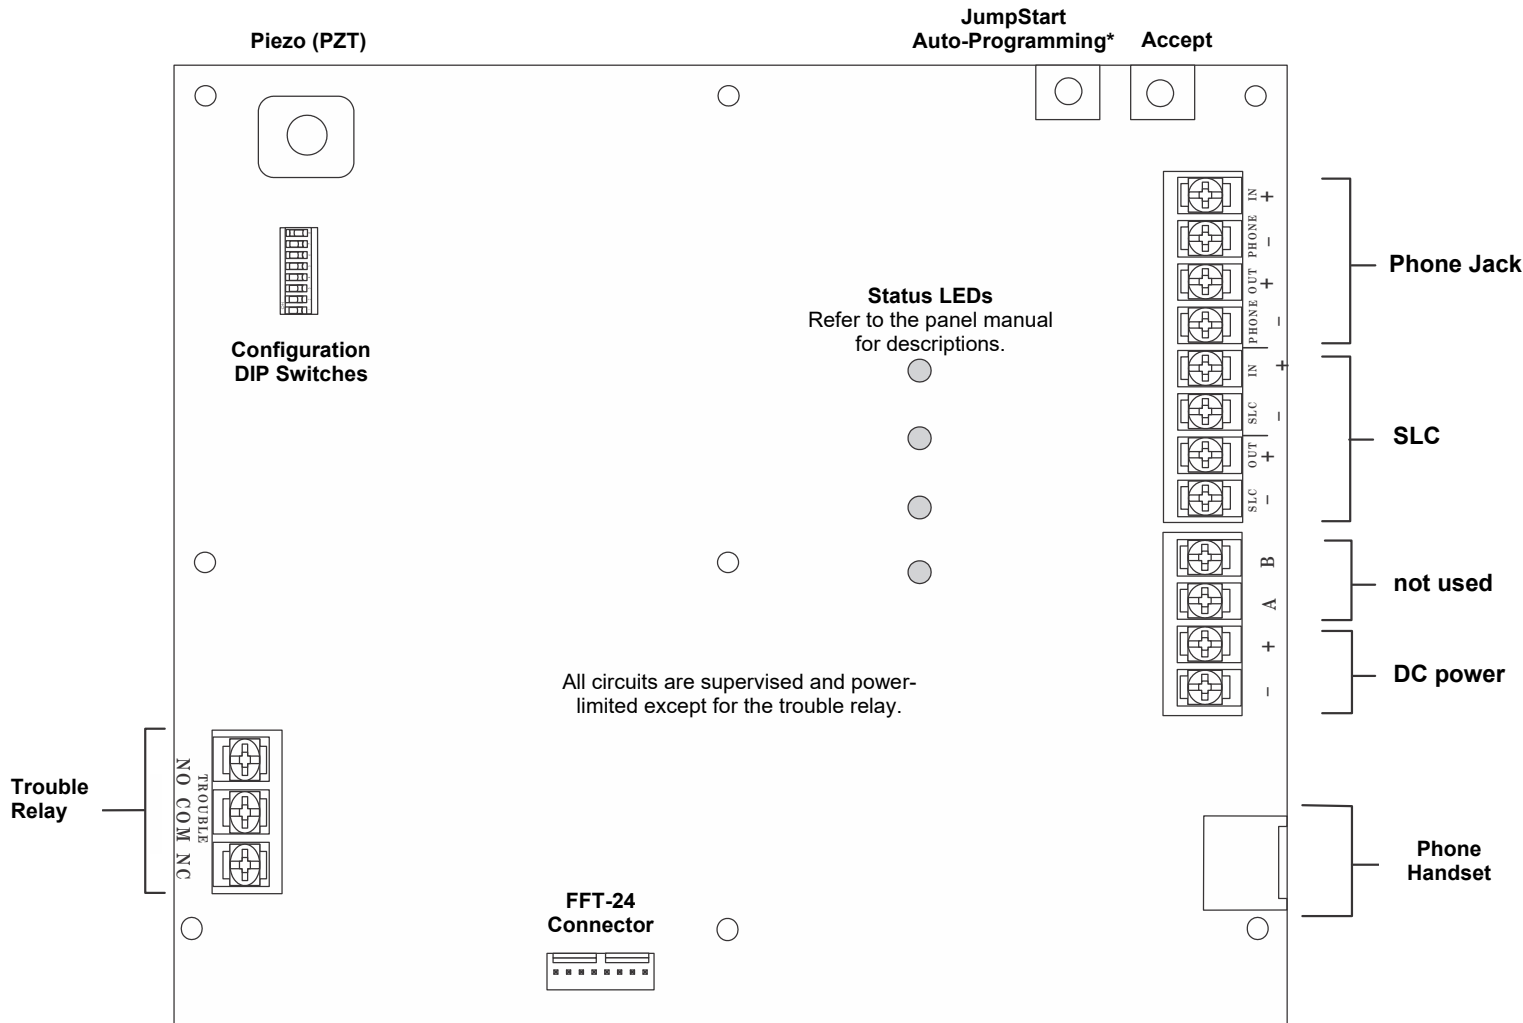

*The SK-FFT Fire Fighters Telephone is equipped with the JumpStart® auto-programming feature which automatically learns how many Fire Fighter phone jacks are installed and their SLC address.

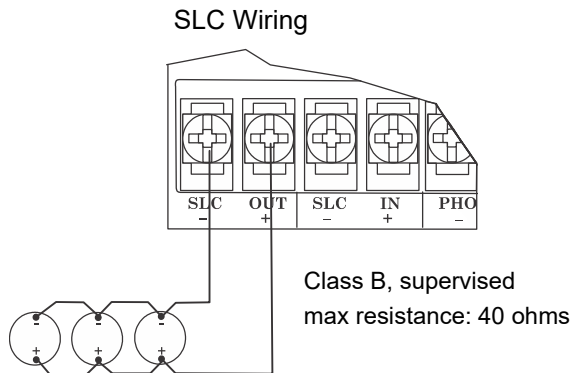

Agency Requirements

NFPA

Install for commercial use in accordance with NFPA 13, NFPA 15, NFPA 16, and NFPA 72.

Intended for indoor use in a dry location.

Circuit	Rating
DC Power (24VDC)	Active: 230 mA
	Standby: 120 mA
Operating Voltage Range	17-29 VDC
Trouble Relay	2.5 A, 24VDC
SLC	50 mA, 32 VDC
Ground fault impedance to any terminal is 0Ω.	

Silent Knight SK-FFT Wiring Diagram

This product is to be installed in accordance with Installation Manual P/N 54711 Rev _____.